


Below is a Williston Herald pic of the fire. Their headline is "Out of Control"

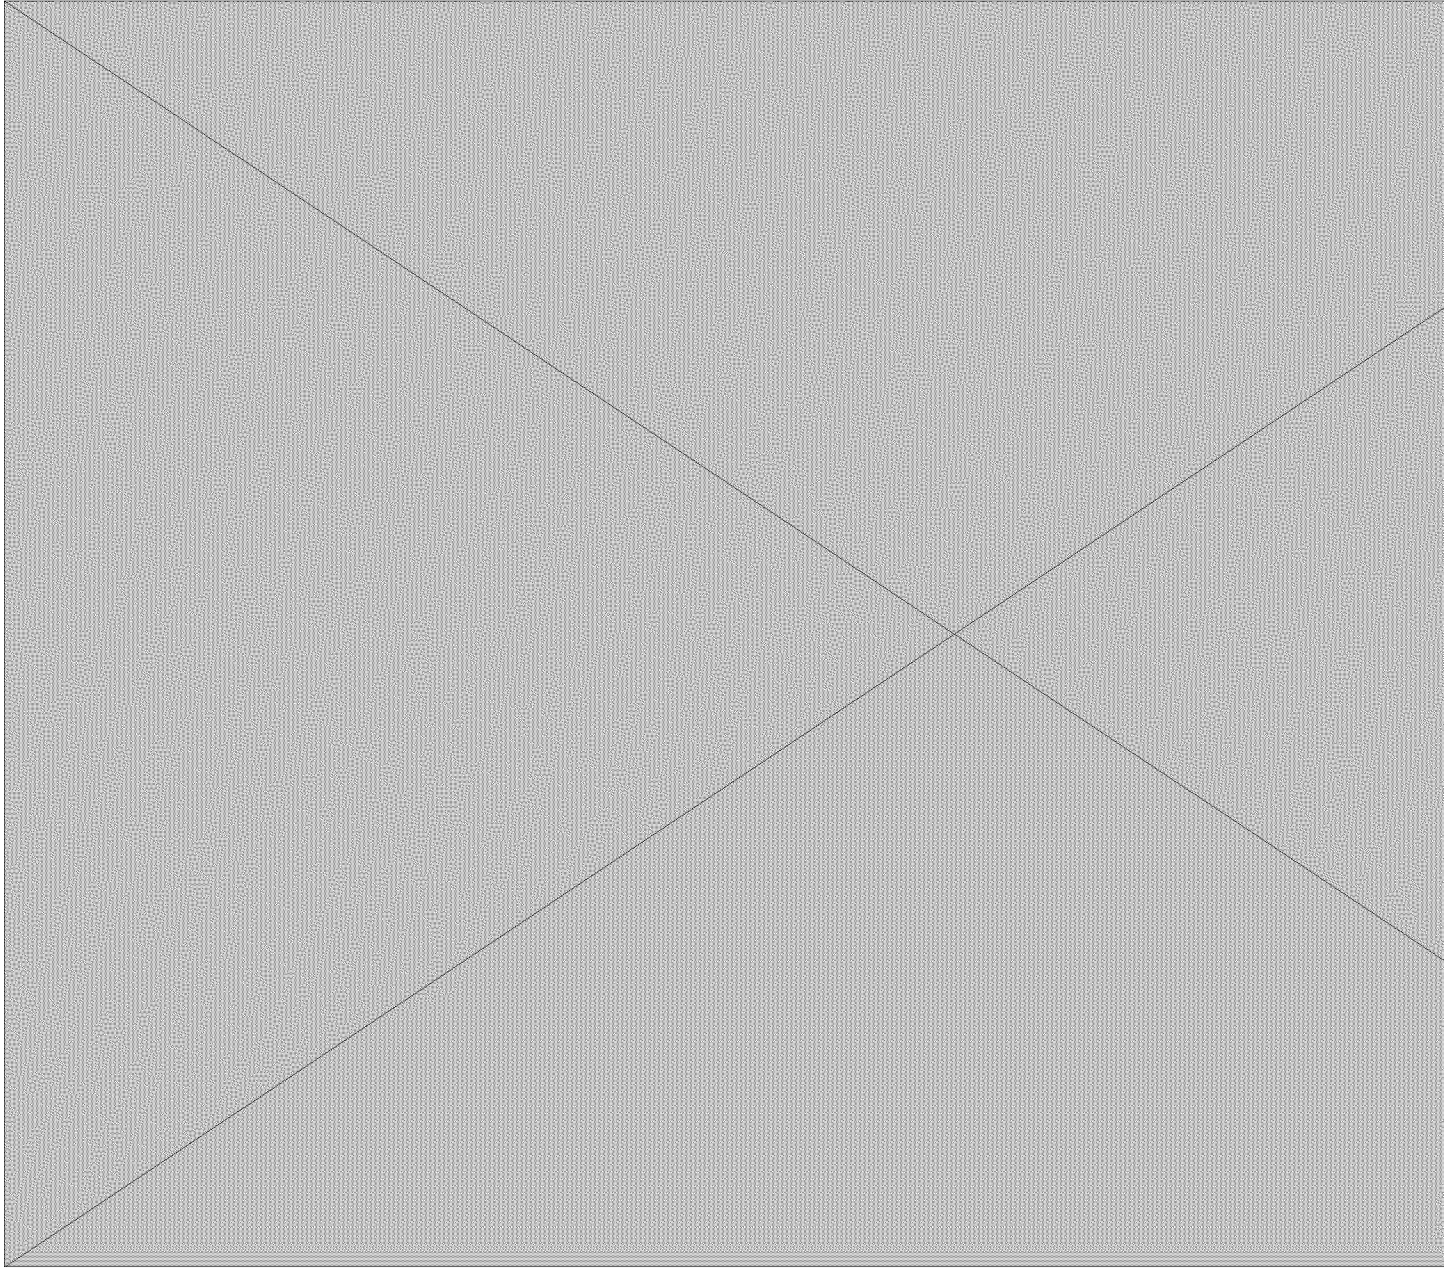

Sean M. Johnson

Plans Officer


ND Department of Emergency Services

Division of Homeland Security

Work: 701-328-8100

Direct: 701-328-8265


Cell: 701-595-6671

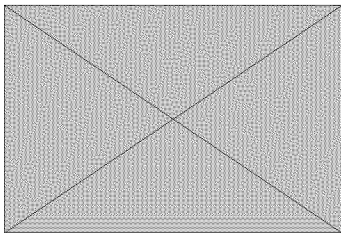

“Ordo ab chao”

(Out of chaos, comes order)

"Incrementalism is the death of innovation " - Nicholas Negroponte

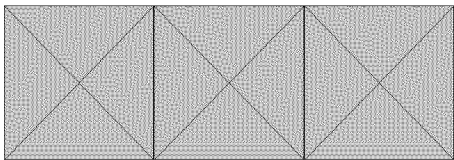

From: Johnson, Sean M.

Sent: Tuesday, July 22, 2014 2:31 AM

To: Glatt, Dave D.; Roberts, Kris D.; Tello-Pool, Mary A.; Upton, Eric J.; Fong, Cecily S.; Lynk, Mike;
cj.craven@minotnd.org

Subject: Fwd: Williston Fire - Red River Supply

Attached is the Tier II report for the facility in question. As you can see we have quite a variety of chemicals to deal with.

Sent from my iPad

Begin forwarded message:

From: "Helen Askim" <HelenA@co.williams.nd.us>
To: "Mike Hallesy" <MikeH@co.williams.nd.us>, "Johnson, Sean M." <smjohnson@nd.gov>
Subject: Williston Fire - Red River Supply

Sean – attached are the Tier II docs. My cell is 701-770-3628 – alternate contact number if you are in a pinch tonight. Will be at the EOC with Hallesy.

Helen Askim
Human Resources Director
Williams County
701.577.4547
williamsnd.com